(A+A)*L

Acoustics and Air Testing Laboratory Co. Ltd.



聲學及空氣測試實驗室有限公司


Noise Isolation Class Measurement in accordance with ASTM E336.

Performed by: Acoustics And Air Testing Laboratory Co. Ltd.

Description of the Test Construction:

Test specimen between Room R12 to Room R13.

f, Hz	NIC, 1/3 oct	NIC, 1/1 oct
100	26.1	
125	28.6	28.4
160	33.4	
200	33.3	3
250	35.6	35.7
315	41.9	
400	41.1	
500	42.7	42.4
630	43.8	
800	43.4	
1000	46.2	43.5
1250	41.9	
1600	41.2	
2000	44.3	43.9
2500	50.0	
3150	51.6	
4000	53.7	53.7
5000	57.7	

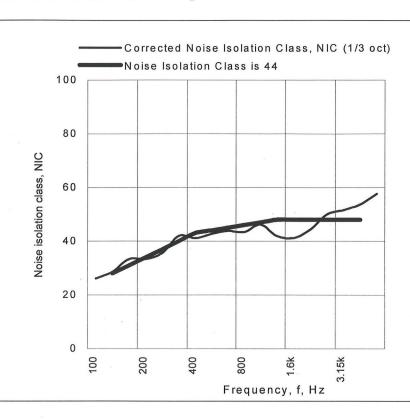

NIC

: 44

Signal

: White noise

Test date

: 30, April 2002

All data and results only refer to the sample being tested.

Prepared by:

Mr. X. T. Leung

ivii. A. II Leurig

Senior Technical Officer

Date: 30, May 2002

Certified by:

Dr. F. Chong

General Manager

Date : 30, May 2002

APJ02-003-RP001

Page 4 of 7